


BU 24563

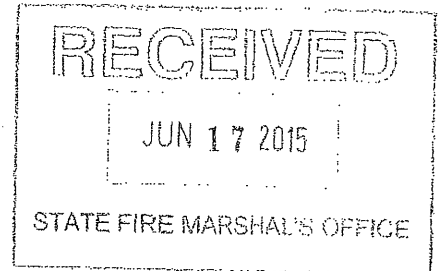

HOPE Worship Center
6851 N. Michigan Road, Indianapolis, IN 46268

Ron Pulliam, Pastor

June 1, 2015

Indiana Department of Fire and Building Services
Office of the State Fire Marshall
402 W. Washington Street, Room E421
Indianapolis, IN 46204-2739

Dear Sir/Madame:

My name is Ron Pulliam, Pastor of Hope of Worship Center. I am appealing the violation NFPA 17a 02 regarding our Hood System at 6851 N. Michigan Road. Although there is a hood in the kitchen area, we do not possess an oven, range, deep fryer or any cooking apparatus that would potentially cause a fire therefore no need for hood maintenance. I contacted the Brown company regarding this issue and they also stated they did not see the need for this service even though they stood to gain money for completing it.

If you require or desire additional documentation I will gladly provide to you. I look forward to a favorable response.

Regards,

Ron Pulliam



FIRE AND BUILDING CODE ENFORCEMENT INSPECTION REPORT ORDER

DIVISION OF FIRE AND BUILDING SAFETY
INDIANA DEPARTMENT OF HOMELAND SECURITY
302 WEST WASHINGTON STREET, RM E241
INDIANAPOLIS, IN 46204
TELEPHONE: 317-232-2222
WEB ADDRESS: WWW.IN.GOV/DHS

| | | |
|--|---|---------------------------------|
| Identification Number BU24563 | Name of the facility HOPE WORSHIP CENTER | County MARION |
| Address of Property 6851 N MICHIGAN RD INDIANAPOLIS | Name of the Contact RON L. PULLIAM | Telephone Number (317) 522- |
| Email ronpullium@yahoo.com | Inspection Date 05/21/2015 | |
| Inspection Category COMPLAINT INVESTIGATION | Inspection Type INITIAL | Inspection Status: VIOLATION |
| Name of the inspector BRET MURRAY | Phone: 3174176652 | |
| Email: bmurray@dhs.in.gov | | |

Violations

| VIO-LATION NUMBER | RULE OR INDIANA CODE SECTION VIOLATED | DESCRIPTION OF VIOLATION | DATE BY WHICH VIOLATION MUST BE CORRECTED |
|-------------------|---|--|---|
| 1 | Sec. 505.1 2014 Edition IFC 675 IAC 22-2.5 | <p>New and existing buildings shall have approved address numbers, building numbers or approved building identification placed in a position that is plainly legible and visible from the street or road fronting the property. These numbers shall contrast with their background. Address numbers shall be provided in additional approved locations to facilitate emergency response. Address numbers shall be Arabic numbers or alphabetical letters. Numbers shall be a minimum of 4 inches (101.6 mm) high with a minimum stroke width of 0.5 inch (12.7 mm). Where access is by means of a private road and the building cannot be viewed from the public way, a monument, pole or other sign or means shall be used to identify the structure. Address numbers shall be maintained.</p> <p>Exception: Secured sites manned with on site, full-time 24 hour response teams who escort responding fire departments may omit address numbers, building numbers or building identification on individual buildings.</p> <p><u>The building address is not visible from the street.</u></p> | 06/19/2015 |
| 2 | Sec. 1011.6.3 2014 Edition IFC 675 IAC 22-2.5 | <p>Exit signs shall be illuminated at all times. To ensure continued illumination for a duration of not less than 90 minutes in case of primary power loss, the sign illumination means shall be connected to an emergency power system provided from storage batteries, unit equipment or an on-site generator. The installation of the emergency power system shall be in accordance with Section 604.</p> <p>Exception: Approved exit sign illumination means that provide continuous illumination independent of external power sources for a duration of not less than 90 minutes, in case of primary power loss, are not required to be connected to an emergency electrical system.</p> <p><u>Exit signs are not working.</u></p> | 06/19/2015 |
| 3 | Sec. 605.5 2014 Edition IFC 675 IAC 22-2.5 | <p>Extension cords and flexible cords shall not be a substitute for permanent wiring. Extension cords and flexible cords shall not be affixed to structures, extended through walls, ceilings or floors, or</p> | 06/19/2015 |

| | | | |
|----|--|---|------------|
| | | <p>under doors or floor coverings, nor shall such cords be subject to environmental damage or physical impact. Extension cords shall be used only with portable appliances.</p> <p><u>Extension cords and flexible cords are be used for permanent wiring.</u></p> | |
| 4 | <p>Sec. 605.5.1 2014 Edition IFC 675 IAC 22-2.5</p> | <p>Extension cords shall be plugged directly into an approved receptacle, and except for approved multipug extension cords, shall serve only one portable appliance.</p> <p><u>Extension cords are plugged together.</u></p> | 06/19/2015 |
| 5 | <p>Sec. 107.2.2 2014 Edition IFC 675 IAC 22-2.5</p> | <p>Written records of maintenance, tests, and inspections shall be maintained on the premises where the equipment is located or at a corporate central office and shall be made immediately available to the inspection authority on request.</p> <p><u>Written records of maintenance, tests, and inspections are not available.</u></p> | 06/19/2015 |
| 6 | <p>Sec. 901.6 2014 Edition IFC 675 IAC 22-2.5</p> | <p>Fire detection, alarm, and extinguishing systems, mechanical smoke exhaust systems, and smoke and heat vents shall be maintained in an operative condition at all times, and shall be replaced or repaired where defective. Nonrequired fire protection systems and equipment shall be inspected, tested and maintained or removed.</p> <p><u>Non-required fire protection systems and equipment shall be inspected, tested and maintained or removed.(The kitchen hood system)</u></p> | 06/19/2015 |
| 7 | <p>Sec. 605.1 2014 Edition IFC 675 IAC 22-2.5</p> | <p>Identified electrical hazards shall be abated. Electrical wiring, devices, appliances and other equipment that is modified or damaged and constitutes an electrical shock or fire hazard shall not be used.</p> <p><u>Open electrical junction box and flammable materials stuck to the electrical power box.</u></p> | 06/19/2015 |
| 8 | <p>Sec. 5.2.1.1.4 2011 Edition NFPA 25 675 IAC 28-1-12</p> | <p>Any sprinkler shall be replaced that has signs of leakage; is painted, other than by the sprinkler manufacturer, corroded, damaged, or loaded; or is in the improper orientation.</p> <p><u>Sprinkler heads have been painted.</u></p> | 06/19/2015 |
| 9 | <p>Sec. 901.7 2014 Edition IFC 675 IAC 22-2.5</p> | <p>Where a required fire protection system is out of service, the fire department and the fire code official shall be notified immediately and, the building shall either be evacuated or an approved fire watch shall be provided for all occupants left unprotected by the shutdown until the fire protection system has been returned to service. Where utilized, fire watches shall be provided with at least one approved means for notification of the fire department and their only duty shall be to perform constant patrols of the protected premises and keep watch for fires.</p> <p><u>The required fire protection system is out of service, the local fire department was not notified. this fact was found out about during the inspection.</u></p> | 06/19/2015 |
| 10 | <p>Sec. 901.4.1 2014 Edition IFC 675 IAC 22-2.5</p> | <p>Fire protection systems required by this code or the International Building Code shall be installed, repaired, operated, tested and maintained in accordance with this code.</p> <p><u>All fire protection shall be maintained.</u></p> | 06/19/2015 |

| | | | |
|----|--|--|------------|
| 11 | Sec. 901.6.2 2014 Edition IFC 675 IAC 22-2.5 | Records of all system inspections, tests and maintenance required by the referenced standards shall be maintained on the premises or made readily available for a minimum of two (2) years from the date of the last inspection, except that original acceptance test reports shall be maintained for the life of the system. <u>Records of all system inspections, tests and maintenance required by the referenced standards are not available.</u> | 06/19/2015 |
|----|--|--|------------|

| Facility Id | Received By Name | Signature and Date |
|-------------|------------------|--------------------|
| BU24563 | | |

APPEAL RIGHTS

Please be advised that if you desire administrative review of this Order and **this Order was delivered by hand**, you must file a written petition for review with the Fire Prevention and Building Safety Commission at 302 West Washington Street, Rm. W246, Indianapolis, IN 46204, identifying the violations for which you seek review no later than 15 calendar days from the hand delivery date of this Order unless such date is a Saturday, Sunday, legal holiday under state statute, or day that the Department of Homeland Security's offices are closed during regular business hours, in which case the deadline would be the first calendar day thereafter that is not a Saturday, Sunday, legal holiday under state statute, or day that the Department of Homeland Security's offices are closed during regular business hours. If you do so, your petition for review will be granted and an administrative proceeding will be conducted by an administrative law judge appointed by the Fire Prevention and Building Safety Commission. If you do not file a petition for review, this Order will be **FINAL** and you **MUST** comply with its requirements.

Please be advised that if you desire administrative review of **this Order and this Order was delivered by first class U.S. mail**, you must file a written petition for review with the Fire Prevention and Building Safety Commission at 302 West Washington Street, Rm. W246, Indianapolis, IN 46204, identifying the violations for which you seek review no later than 18 calendar days from the mailing date of this Order unless such date is a Saturday, Sunday, legal holiday under state statute, or day that the Department of Homeland Security's offices are closed during regular business hours, in which case the deadline would be the first calendar day thereafter that is not a Saturday, Sunday, legal holiday under state statute, or day that the Department of Homeland Security's offices are closed during regular business hours. If you do so, your petition for review will be granted and an administrative proceeding will be conducted by an administrative law judge appointed by the Fire Prevention and Building Safety Commission. If you do not file a petition for review, this Order will be **FINAL** and you **MUST** comply with its requirements.

Please be further advised that you may request an opportunity to informally discuss this Order prior to filing a petition for review. Such informal discussion, or a request therefor, does not extend the deadline for filing a petition for review and, therefore, any request for an informal discussion should be made promptly, preferably by telephone, upon receipt of this Order.